


Marietta Fire Department

<p>Fire Marshal's Office</p>  <p>Plan Review</p>	<p>NFPA 13D Plan Review Checklist^{1,2}</p> <p>Job Name: _____</p> <p>Address: _____ Bldg: _____ Suite: _____</p> <p>City: _____ Zip: _____</p> <p>GENERAL BUILDING INFORMATION:</p> <p>Area of Building: _____ Number of Stories _____</p> <p><input type="checkbox"/> New System <input type="checkbox"/> Retrofit Building plans on file <input type="checkbox"/> Y <input type="checkbox"/> N</p> <p>Sprinkler Company: _____</p> <p>Responsible Party: _____ Phone: _____</p> <p>Email: _____</p>
--	--

✓ = Provided, X = Not Provided, NA = Not applicable


Status

DRAWING/SUBMITTAL REQUIREMENTS	
1) Permitted name and address on each page of the plans with applicable design code(s) [4.5]	
2) Each page of plans and coversheet of calculations must have seal, date, and signature of the qualified sprinkler designer [120-3-19-.11(1)]	
3) All submittals must be made through SagesGov - Provide a set of drawings; a set of hydraulic calculations; and materials used on the project [AHJ]	
4) Plans shall be drawn to a common scale or have all dimensions clearly marked [4.4, AHJ]	
5) Clearly label each room and/or identify use [4.4, AHJ]	
6) Provide overhead view; include piping configuration; include ceiling fixtures (i.e. fans, lights, etc.) [8.2.5]	
7) Provide water supply information, flow test, and 24-hour demand graph on plans [4.4, 10.1.2]	
8) Provide a cut sheet for each type of sprinkler head used (include on CD) [4.3, 4.5]	
9) Show make, model, size, K-factor, temperature, style, quantity, and flow demand for all sprinkler heads [4.4]	
10) Show riser detail, including pressure gauge (above and below check valves) [7.3] and alarm [7.6]. Do NOT install the optional sprinkler control valve ³ .	
11) Local water flow alarm location or call out exception [7.6]	
12) Provide freeze protection/insulation detail [9.1]	
13) Show detail of all hangers used [4.4, 7.4]	
14) Identify or call out maximum head spacing [8.1.3.1]	
15) Identify and provide detail for each pipe material used [4.4]	
16) Identify and call out remote/design area for a 2-head flow test [4.4, 10.2.1. (AHJ)]	
17) Callout/provide remote/design area hydraulic data [4.4]	
18) Provide hydraulic calculations in accordance with chapter 10	

¹ The above is not an all-inclusive list; all applicable fire and life safety provisions must be met.

² NFPA 13D, 2019 Edition (No current SFMO Modifications)

³ See Figure A.6.2(c) on Right

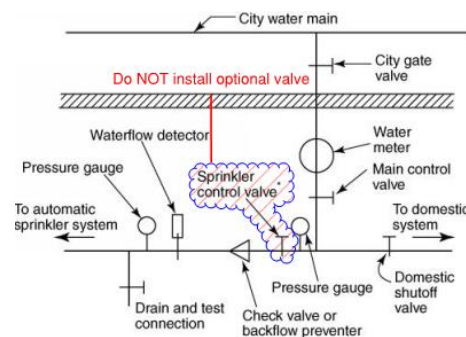

Notes: _____

Reviewer: _____ Date: _____