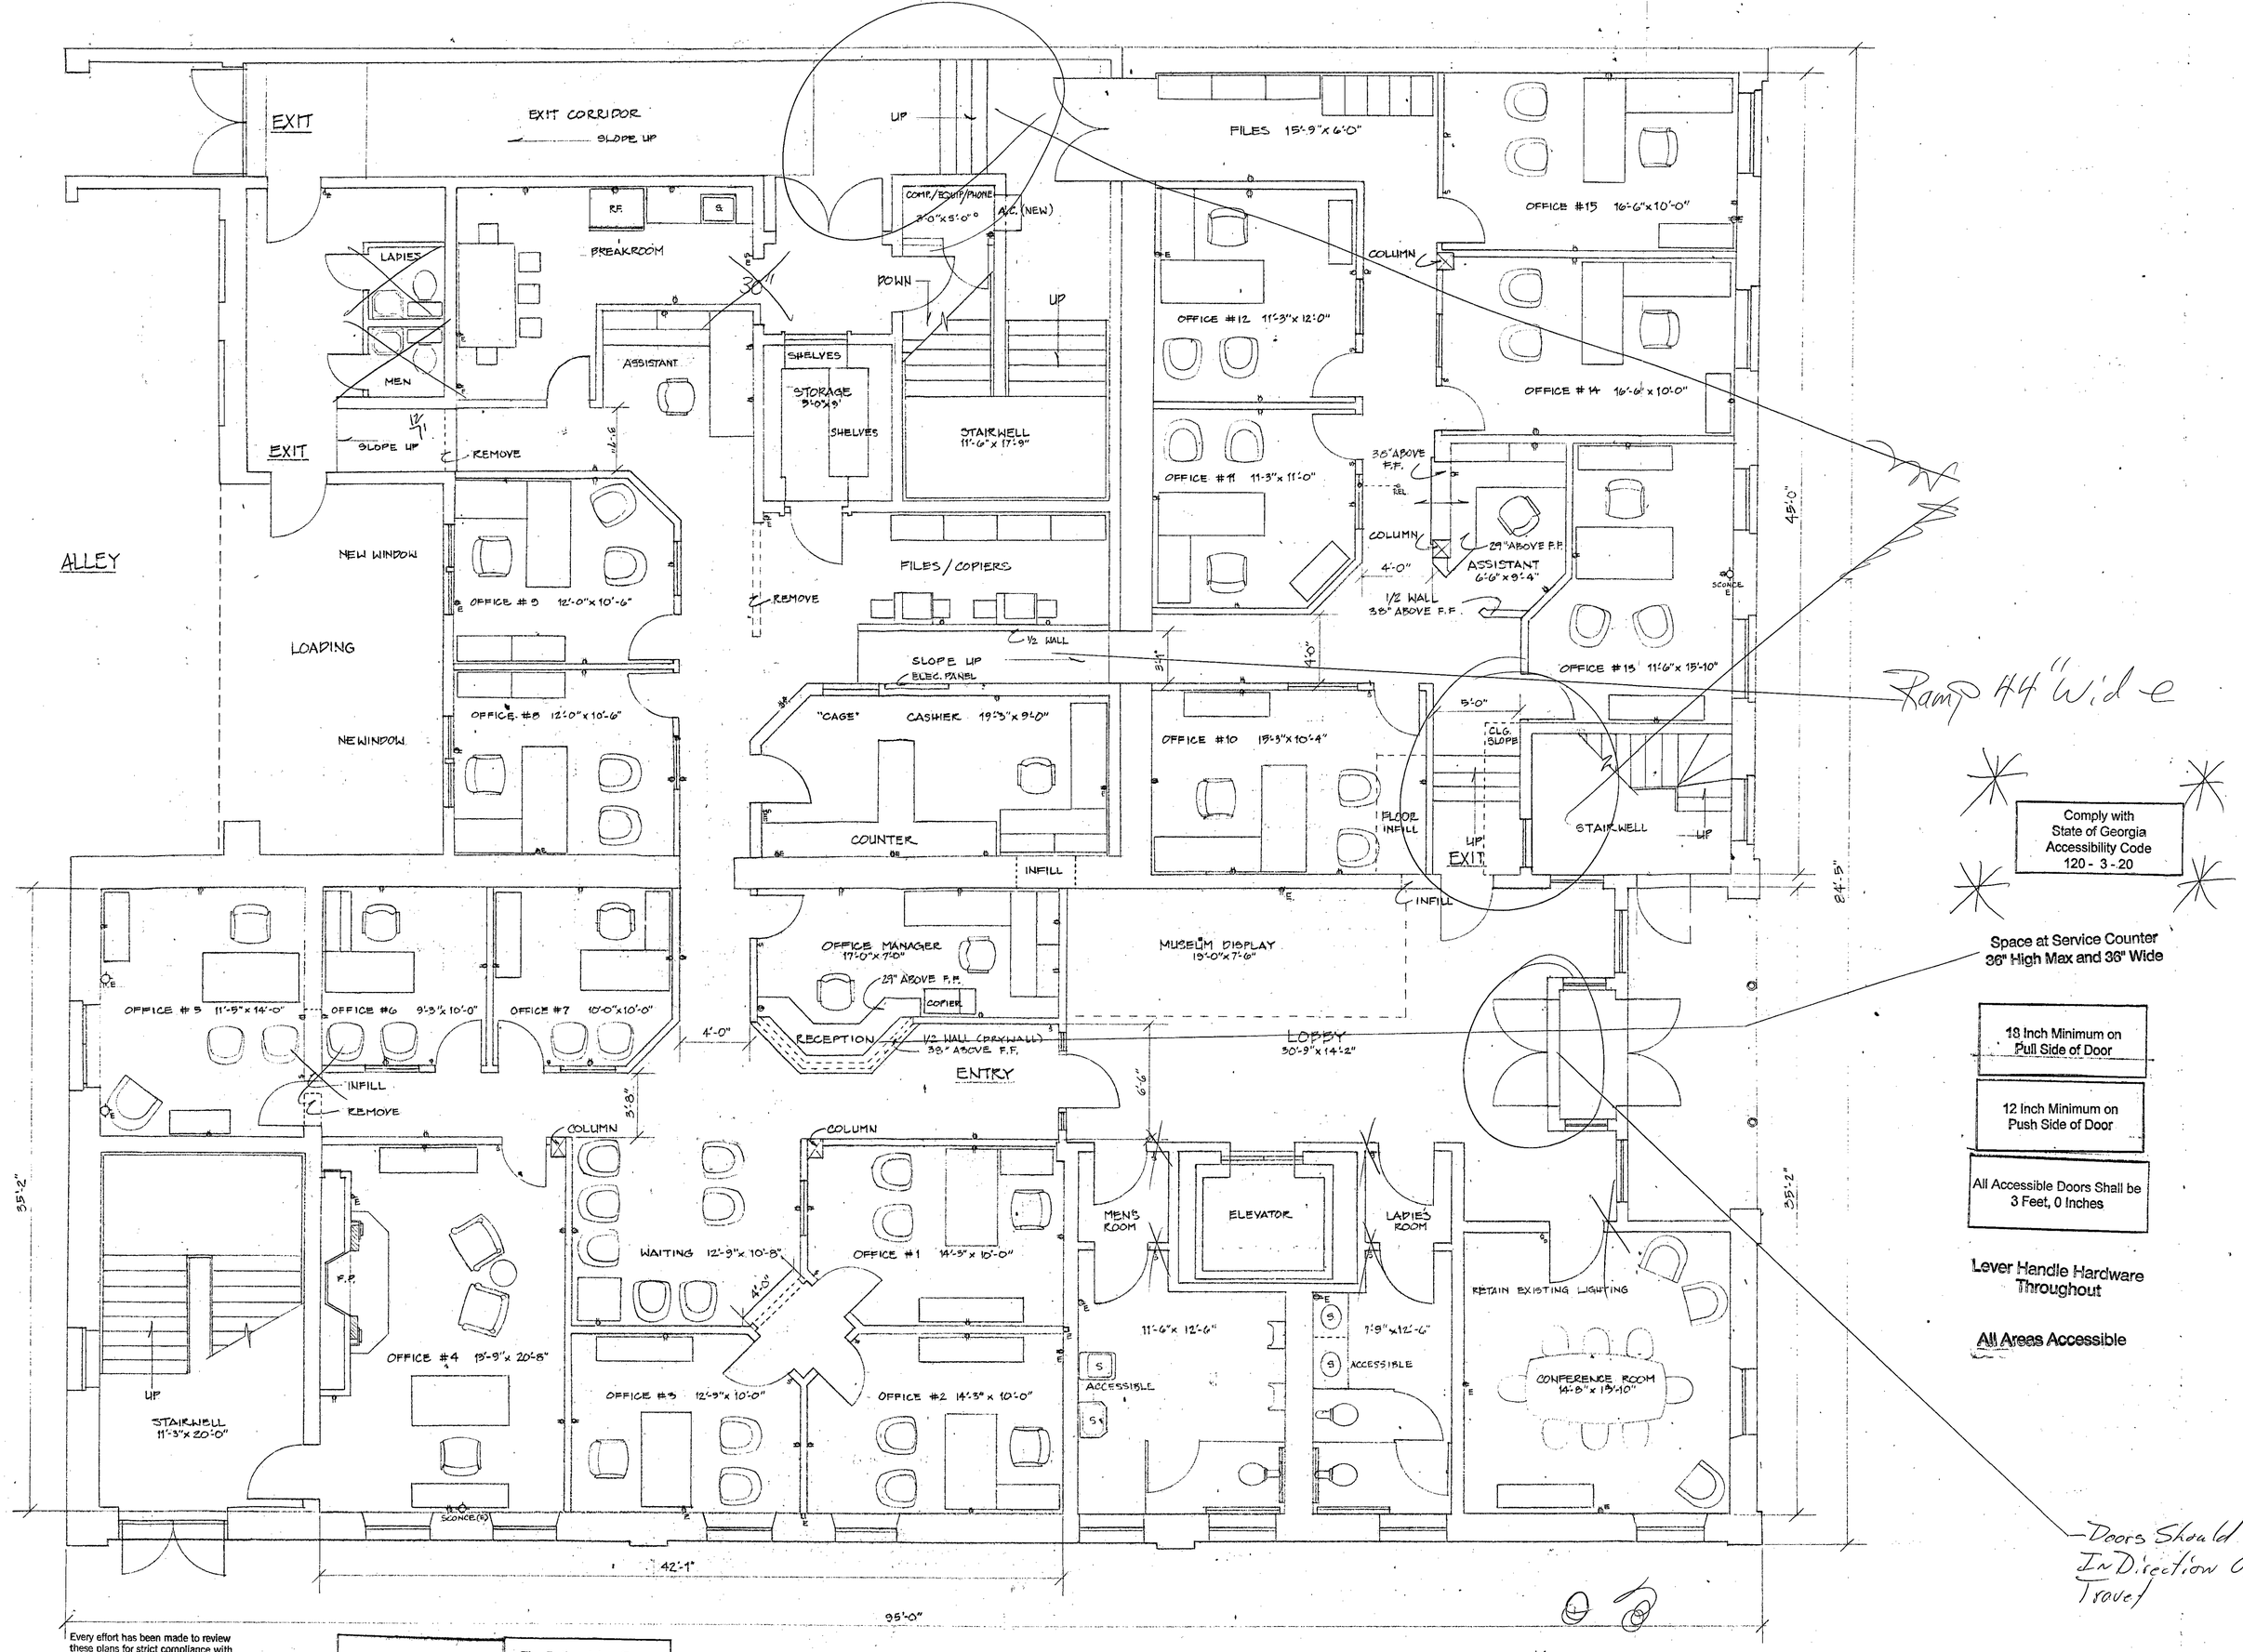

Every effort has been made to review these plans for strict compliance with city and state fire codes. However, the contractor or owner shall remain responsible for compliance of any code violations discovered subsequent to the plan review.

Signed [signature] Date 3/15/99
Bureau of Fire Prevention
Marietta Fire Department

To Comply with: N.F.P.A. 101
Life Safety Code 1997 Edition,
Chapter 26

Emergency Lighting with Battery Backup	Fire Extinguisher Every 75 Feet of Travel, Tagged and Mounted
Exit Signs with Battery Backup	Call for an 80% and a 100% Inspection

= Rated Walls

future home of
A. G. Edwards & Sons Inc.
Kennesaw House - Marietta Georgia
Developer: Deventer Group
Designer: Richard E. Burgess
January 1999

KEY
- OUTLET 110 (100)
- OUTLET EXISTING
- SWITCH EXISTING
- S SWITCH (25)
- EXISTING ELEC. BOX IN WALL