


## HANDRAIL REQUIREMENTS

Handrails to be within

30" max - New stairs &amp; ramps

44" max - Existing stairs &amp; ramps

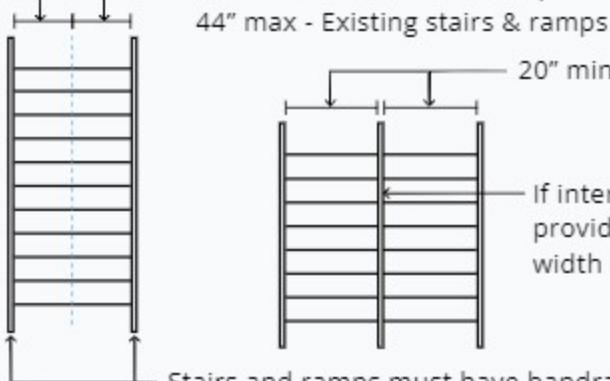

Stairs and ramps must have handrails on both sides.

A handrail is not required at a single step or ramp that is part of a curb that separates sidewalk from vehicular way


Handrails only required on one side for Existing stairs and ramps and New and Existing stairs and ramps within dwelling units

Handrails that form part of a guard shall be 42" max. Existing guards on existing stairs are permitted to be 30" min but must be 36" min in dwelling units.

Handrails to extend 12" beyond top landing and for at least one tread below the lowest riser at the bottom of stairs. Not required in dwelling units.

34" - 38" - New handrails

30" - 38" - Existing handrails

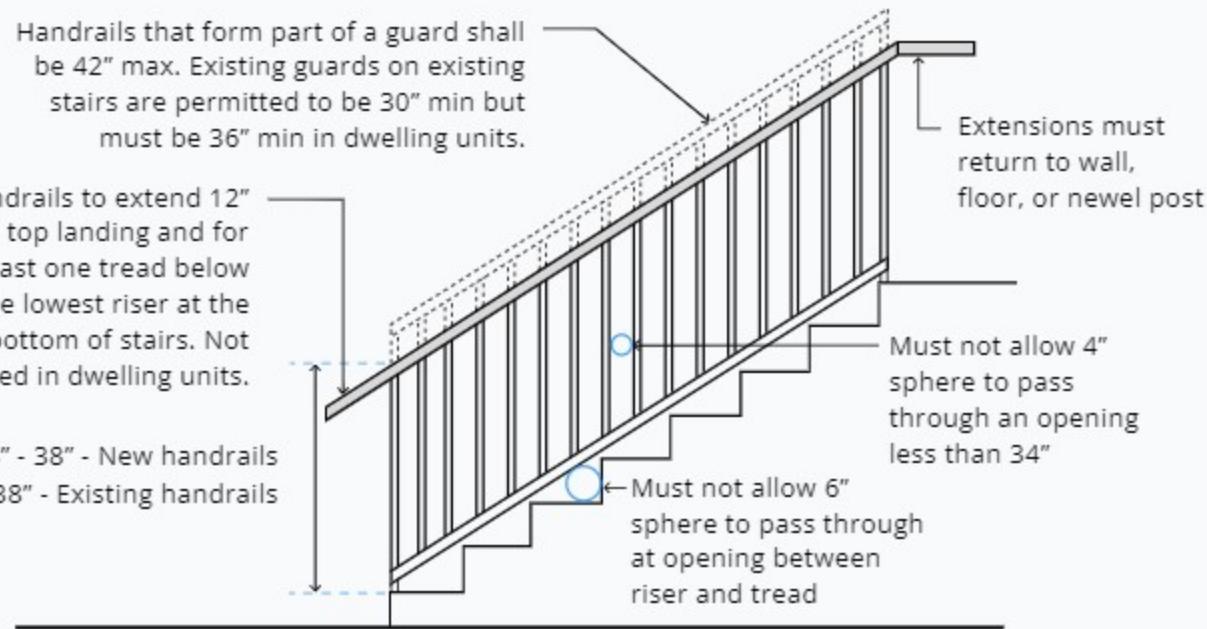

Handrails that form part of a guard shall be 42" max

